
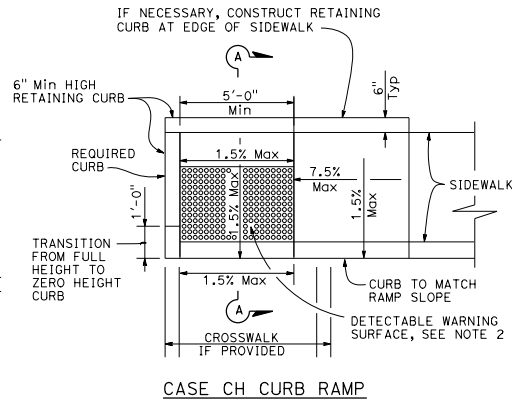
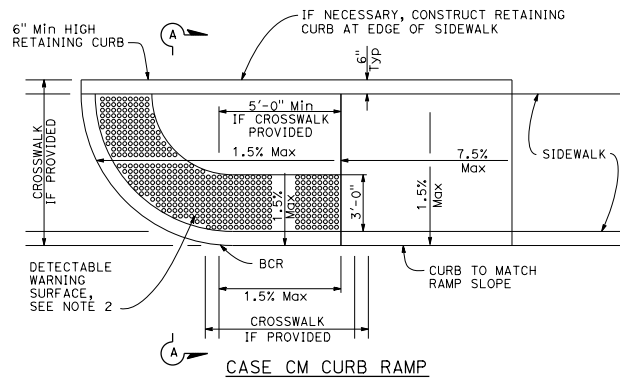
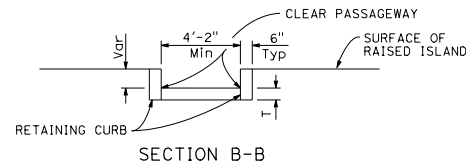
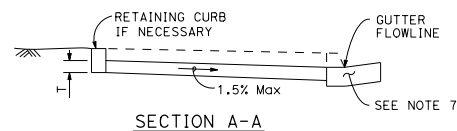
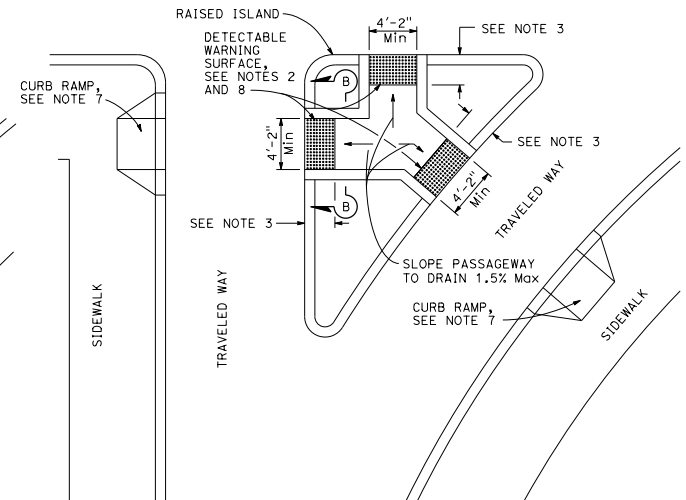
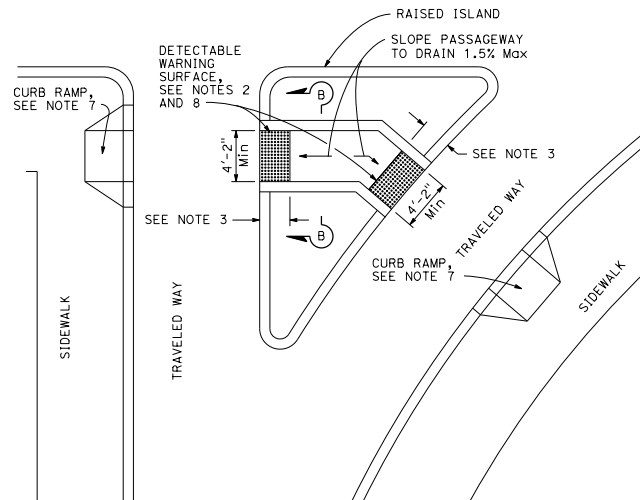


Gutter not shown

**NOTES:**

1. Sidewalk, ramp and passageway thickness, "T", shall be 3 1/2" minimum.
2. For details of detectable warning surfaces, see Standard Plan A88A.
3. Where an island passageway length is greater than or equal to 8'-0", but less than 8'-0", each detectable warning surface shall extend the full width and 2'-0" depth of the passageway length. Where an island passageway length is greater than or equal to 8'-0", each detectable warning surface shall extend the full width and 3'-0" depth of the passageway length. Detectable warning surfaces shall extend the full width of the island passageway except a maximum gap of 1 inch is allowed on each side of the passageway.
4. The adjacent surfaces at transitions at curb ramps to walks, gutters, and streets shall be at the same level.
5. Utility pull boxes, manholes, vaults and all other utility facilities within the boundaries of the curb ramp will be relocated or adjusted to grade by the owner prior to, or in conjunction with, curb ramp construction.
6. Detectable warning surface may have to be cut to allow removal of utility covers while maintaining detectable warning width and depth.
7. For additional curb ramp details, see Standard Plan A88A.
8. The detectable warning surface will be a rectangle as shown at the face of curb, unless modified in the Project Plans.

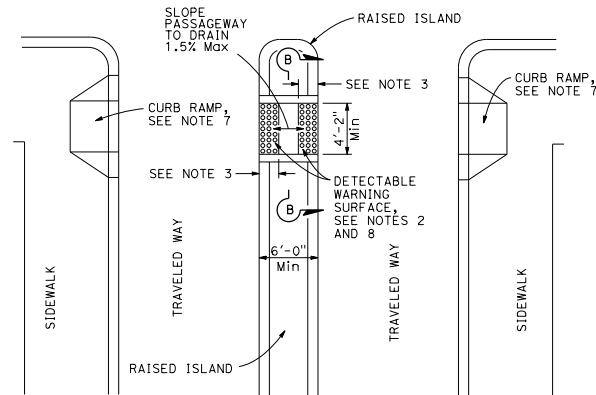

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION
**CURB RAMP AND
ISLAND PASSAGEWAY DETAILS**
NO SCALE

A88B

DIST	COUNTY	ROUTE	POST MILES	SHEET TOTAL
			TOTAL PROJECT	NO. SHEETS

Registered Civil Engineer
 May 31, 2018
 PLANS APPROVAL DATE
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

Rebecca Lynn Maury
 No. C54415
 Exp. 12-31-19
 CIVIL
 STATE OF CALIFORNIA